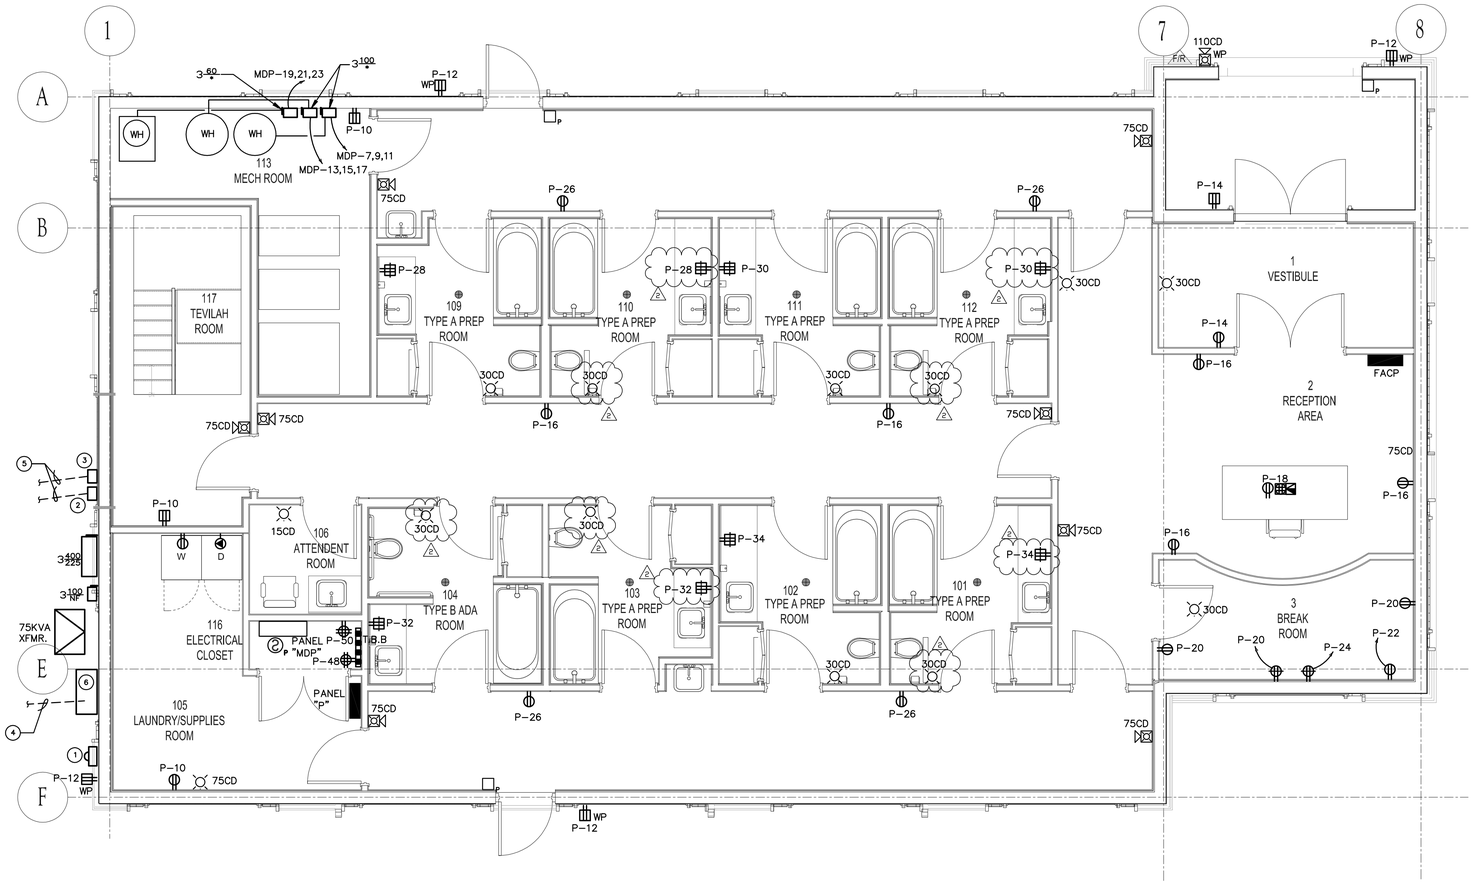


KEY NOTES

1. PROPOSED METER LOCATION. COORDINATE EXACT LOCATION AND WORK WITH CONTRACTOR PRIOR TO BIDDING.
2. PROPOSED CATV SERVICE BOX IN GROUND. COORDINATE EXACT LOCATION AND WORK WITH SERVICE REP. PRIOR TO BIDDING.
3. PROPOSED TELCO SERVICE BOX IN GROUND, COORDINATE EXACT LOCATION AND WORK WITH SERVICE REP. PRIOR TO BIDDING.
4. ROUTED SERVICE LINES AT 24" B.F.G. COORDINATE ROUTING OF THE U/G SERVICE CONDUITS.
5. 1-2" PVC SCHED. 40, FOR CATV.
   2-3" PVC SCHED. 40, FOR TELE/DATA.
   COORDINATE FINAL CONDUIT TERMINATION WITH COMPANY'S ENGINEER PRIOR TO BID/INSTALLATION.
6. CT CAN.

1 MIKVAH LEVEL - ELECTRICAL PLAN
1/4" = 1'-0"

RISE | FL architecture

ARCHITECT:

NYC OFFICE:
241 37TH STREET, SUITE 440
BROOKLYN, NEW YORK 11232
JEFF AKERMAN, RA
JEFF@RISEARCHITECTURE.COM
516-249-3746

NJ OFFICE:
36 AIRPORT RD SUITE 402
LAKEWOOD, NJ 08701
SHIMON GREENEBAUM, RA
SHIMON@RISEARCHITECTURE.COM
908-674-8717

FL OFFICE:
210 N UNIVERSITY DR SUITE 210
CORAL SPRINGS, FL 33071
SHIMON GREENEBAUM, RA
SHIMON@RISEARCHITECTURE.COM
908-674-8717

STRUCTURAL CONSULTANT:

MEP CONSULTANT:
DELTA G CONSULTING ENGINEERS, INC.
1600 Eller Drive, Suite 320
Fort Lauderdale, FL, 33316
(954) 527-1112
CA#00009181
FPT: MGR-IGSR-LONGRIVER/C
PROJECT #: 23001.5.0
(Okeechobee Falls.pln)
Digitally signed by George Sanjuan
Date: 2024.08.05 11:06:33 -04'00'

CIVIL CONSULTANT:

REVISIONS:

NO.	DATE	DESCRIPTION
1	3-29-2024	RESPONSE TO COMMENTS
2	6-13-2024	COORDINATION

CLIENT:
CLIENT NAME

PROJECT NAME / LOCATION:
MIKVAH
OKEECHOBEE, FL

DRAWING TITLE:
MIKVAH LEVEL ELECTRICAL PLAN

EXAMINER'S SIGNATURE:

PROFESSIONAL SEAL:

GEORGE SANJUAN P.E.
FLORIDA LICENSE #46100

SCALE: 1/4" = 1'-0"

DATE:

PROJECT NO.

E101

DRAWING NO.
06

BARCODE

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE ARCHITECTS. DO NOT SCALE DRAWING. THE DRAWING SHALL NOT BE USED UNTIL SIGNED BY CONSULTANTS.

7/25/2023 2:53:09 PM