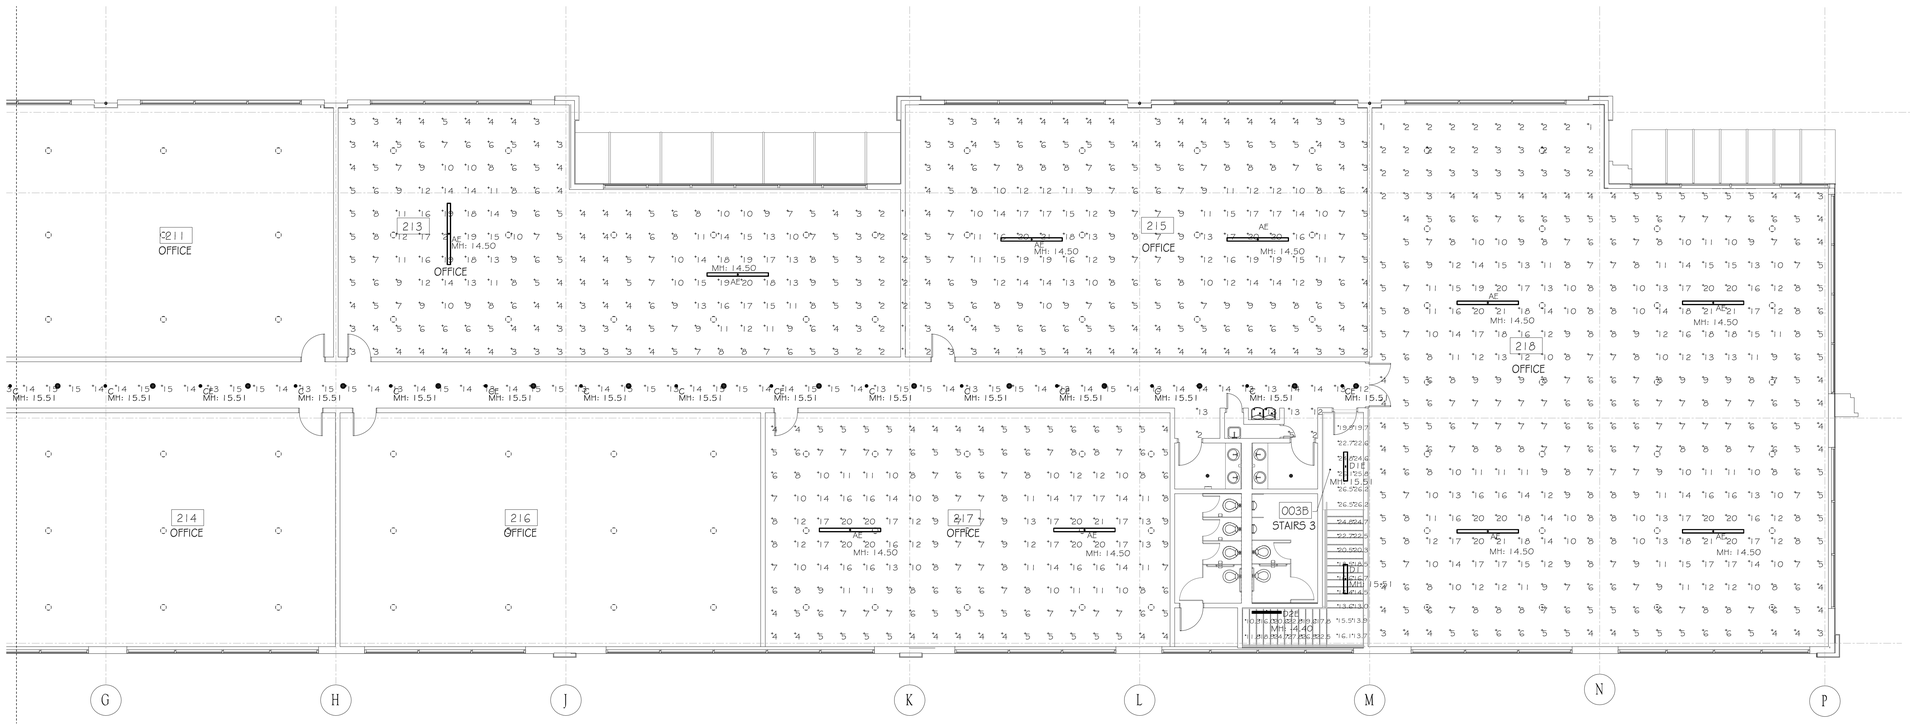



1 Level 2 - Area C - Photometrics Plan - Normal
1/8" = 1'-0"

**Luminaire Scheduler OKEECHOBEE RETAIL SHELL BUILDING - SECOND FLOOR 08/29/2023**

**Scenes NORMAL**

| Symbol | Qty | Label | Manufacturer | Catalog Number | Mounting | Emergency | LLF | Luminaire Lumens | Luminaire Watts |
|---|---|---|---|---|---|---|---|---|---|
| | 29 | AE | Lithonia Lighting | CLX L96 10000LM SEF WDL MVOLT 40K 80CRI E10WLCP | PENDANT MOUNT A.F.F. (bottom of fixture) | BATTERY | 0.855 | 10134 | 63.6547 |
| | 2 | B | Lithonia Lighting | CLX L48 10000LM SEF WDL MVOLT 40K 80CRI | PENDANT MOUNT A.F.F. (bottom of fixture) | | 0.855 | 10154 | 70.6697 |
| | 36 | C | Alphabet Lighting | NU4-RD-SW-40LM-30K-80-WH70-120-DIM10-NC-WH-WH | RECESSED MOUNT A.F.F. | | 0.855 | 3040 | 30.5 |
| | 20 | CE | Alphabet Lighting | NU4-RD-SW-40LM-30K-80-WH70-120-DIM10-NC-WH-WH-EM7 | RECESSED MOUNT A.F.F. | BATTERY | 0.855 | 3040 | 30.5 |
| | 2 | D1 | Luminaire LED | TSLS-66IN-100W-40K-MVOLT CLP | SURFACE MOUNT A.F.F. | | 0.855 | 11048 | 114.6 |
| | 3 | D1E | Luminaire LED | TSLS-66IN-100W-40K-MVOLT CLP EMB310 | SURFACE MOUNT A.F.F. | BATTERY | 0.855 | 11048 | 114.6 |
| | 1 | D2 | Luminaire LED | TSLS-66IN-100W-40K-MVOLT CLP | WALL MOUNT A.F.F. | | 0.855 | 11048 | 114.6 |
| | 2 | D2E | Luminaire LED | TSLS-66IN-100W-40K-MVOLT CLP EMB310 | WALL MOUNT A.F.F. | BATTERY | 0.855 | 11048 | 114.6 |

**Calculation Summary: OKEECHOBEE RETAIL SHELL BUILDING - SECOND FLOOR 08/29/2023**

**Scenes NORMAL**

| Label | Calc Type | Units | Avg | Max | Min | Avg/Min | Max/Min |
|---|---|---|---|---|---|---|---|
| 200 OFFICE_Workplane | Illuminance | Fc | 8.47 | 21 | 2 | 4.24 | 10.50 |
| 201 OFFICE_Workplane | Illuminance | Fc | 11.66 | 24 | 2 | 5.83 | 12.00 |
| 202 OFFICE_Workplane | Illuminance | Fc | 11.72 | 22 | 5 | 2.34 | 4.40 |
| 206 OFFICE_Workplane | Illuminance | Fc | 14.12 | 24 | 6 | 2.35 | 4.00 |
| 207 OFFICE_Workplane | Illuminance | Fc | 9.12 | 22 | 1 | 9.12 | 22.00 |
| 209 OFFICE_Workplane | Illuminance | Fc | 9.09 | 22 | 2 | 4.55 | 11.00 |
| 210 OFFICE_Workplane | Illuminance | Fc | 9.56 | 23 | 2 | 4.78 | 11.50 |
| 212 OFFICE_Workplane | Illuminance | Fc | 7.77 | 21 | 2 | 3.89 | 10.50 |
| 213 OFFICE_Workplane | Illuminance | Fc | 7.22 | 21 | 1 | 7.22 | 21.00 |
| 215 OFFICE_Workplane | Illuminance | Fc | 7.65 | 21 | 2 | 3.83 | 10.50 |
| 217 OFFICE_Workplane | Illuminance | Fc | 8.89 | 21 | 4 | 2.22 | 5.25 |
| 218 OFFICE_Workplane | Illuminance | Fc | 8.42 | 21 | 1 | 8.42 | 21.00 |
| BATHROOM MEN'S_Floor | Illuminance | Fc | 39.90 | 50 | 21 | 1.90 | 2.38 |
| BATHROOM WOMEN'S_Floor | Illuminance | Fc | 39.48 | 50 | 22 | 1.79 | 2.27 |
| CORRIDOR_Floor | Illuminance | Fc | 14.64 | 23 | 2 | 7.32 | 11.50 |
| JAN CLOSET_Floor | Illuminance | Fc | 38.00 | 38 | 38 | 1.00 | 1.00 |
| SMALL ROOM (left of women's)_Floor | Illuminance | Fc | 30.33 | 31 | 30 | 1.01 | 1.03 |
| 002A STAIRS 1 | Illuminance | Fc | 27.48 | 38.4 | 14.3 | 1.92 | 2.69 |
| 003B STAIRS 3 | Illuminance | Fc | 20.27 | 27.8 | 10.3 | 1.97 | 2.70 |


RISE | FL architecture

ARCHITECT:

NYC OFFICE:
241 37TH STREET, SUITE 440
BROOKLYN, NEW YORK, 11232
JEFF AKERMAN, RA
JEFF@RISEARCHITECTURE.COM
516.249.3746

NJ OFFICE:
36 AIRPORT R, SUITE 400
LAKEWOOD, NJ 08701
SHIMON GREENBAUM, RA
SHIMON@RISEARCHITECTURE.COM
908.674.8717

FL OFFICE:
210 N UNIVERSITY DR SUITE 210
CORAL SPRINGS, FL 33071
SHIMON GREENBAUM, RA
SHIMON@RISEARCHITECTURE.COM
908.674.8717

STRUCTURAL CONSULTANT:

MEP CONSULTANT:
DELTA G CONSULTING ENGINEERS, INC.
1600 Eller Drive, Suite 370
Fort Lauderdale, FL. 33316
(954) 527-1112
CA#00009181
PJT. MGR: STEPHEN BENDER, P.E.
PROJECT #: 230515-G

CIVIL CONSULTANT:

DESIGNER CONSULTANT:


REVISIONS:

| NO. | DATE | DESCRIPTION |
|---|---|---|

CLIENT:
CLIENT NAME

PROJECT NAME / LOCATION:
PROJECT NAME
PROJECT ADDRESS

DRAWING TITLE:
LEVEL 2 - AREA C - PHOTOMETRICS PLAN - NORMAL

EXAMINER'S SIGNATURE:

PROFESSIONAL SEAL:
Digitally signed by George SanJuan
Date: 2023.12.27 11:19:29 -05'00'
GEORGE SANJUAN, P.E.
FLORIDA LICENSE #46100

SCALE: AS SHOWN
DATE:
PROJECT NO:
EPH203
DRAWING NO:

BARCODE


THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE ARCHITECTS. DO NOT SCALE DRAWING. THE DRAWING SHALL NOT BE USED UNTIL SIGNED BY CONSULTANTS.